


Water Supply by Other
500 LITRE MAKE UP TANK

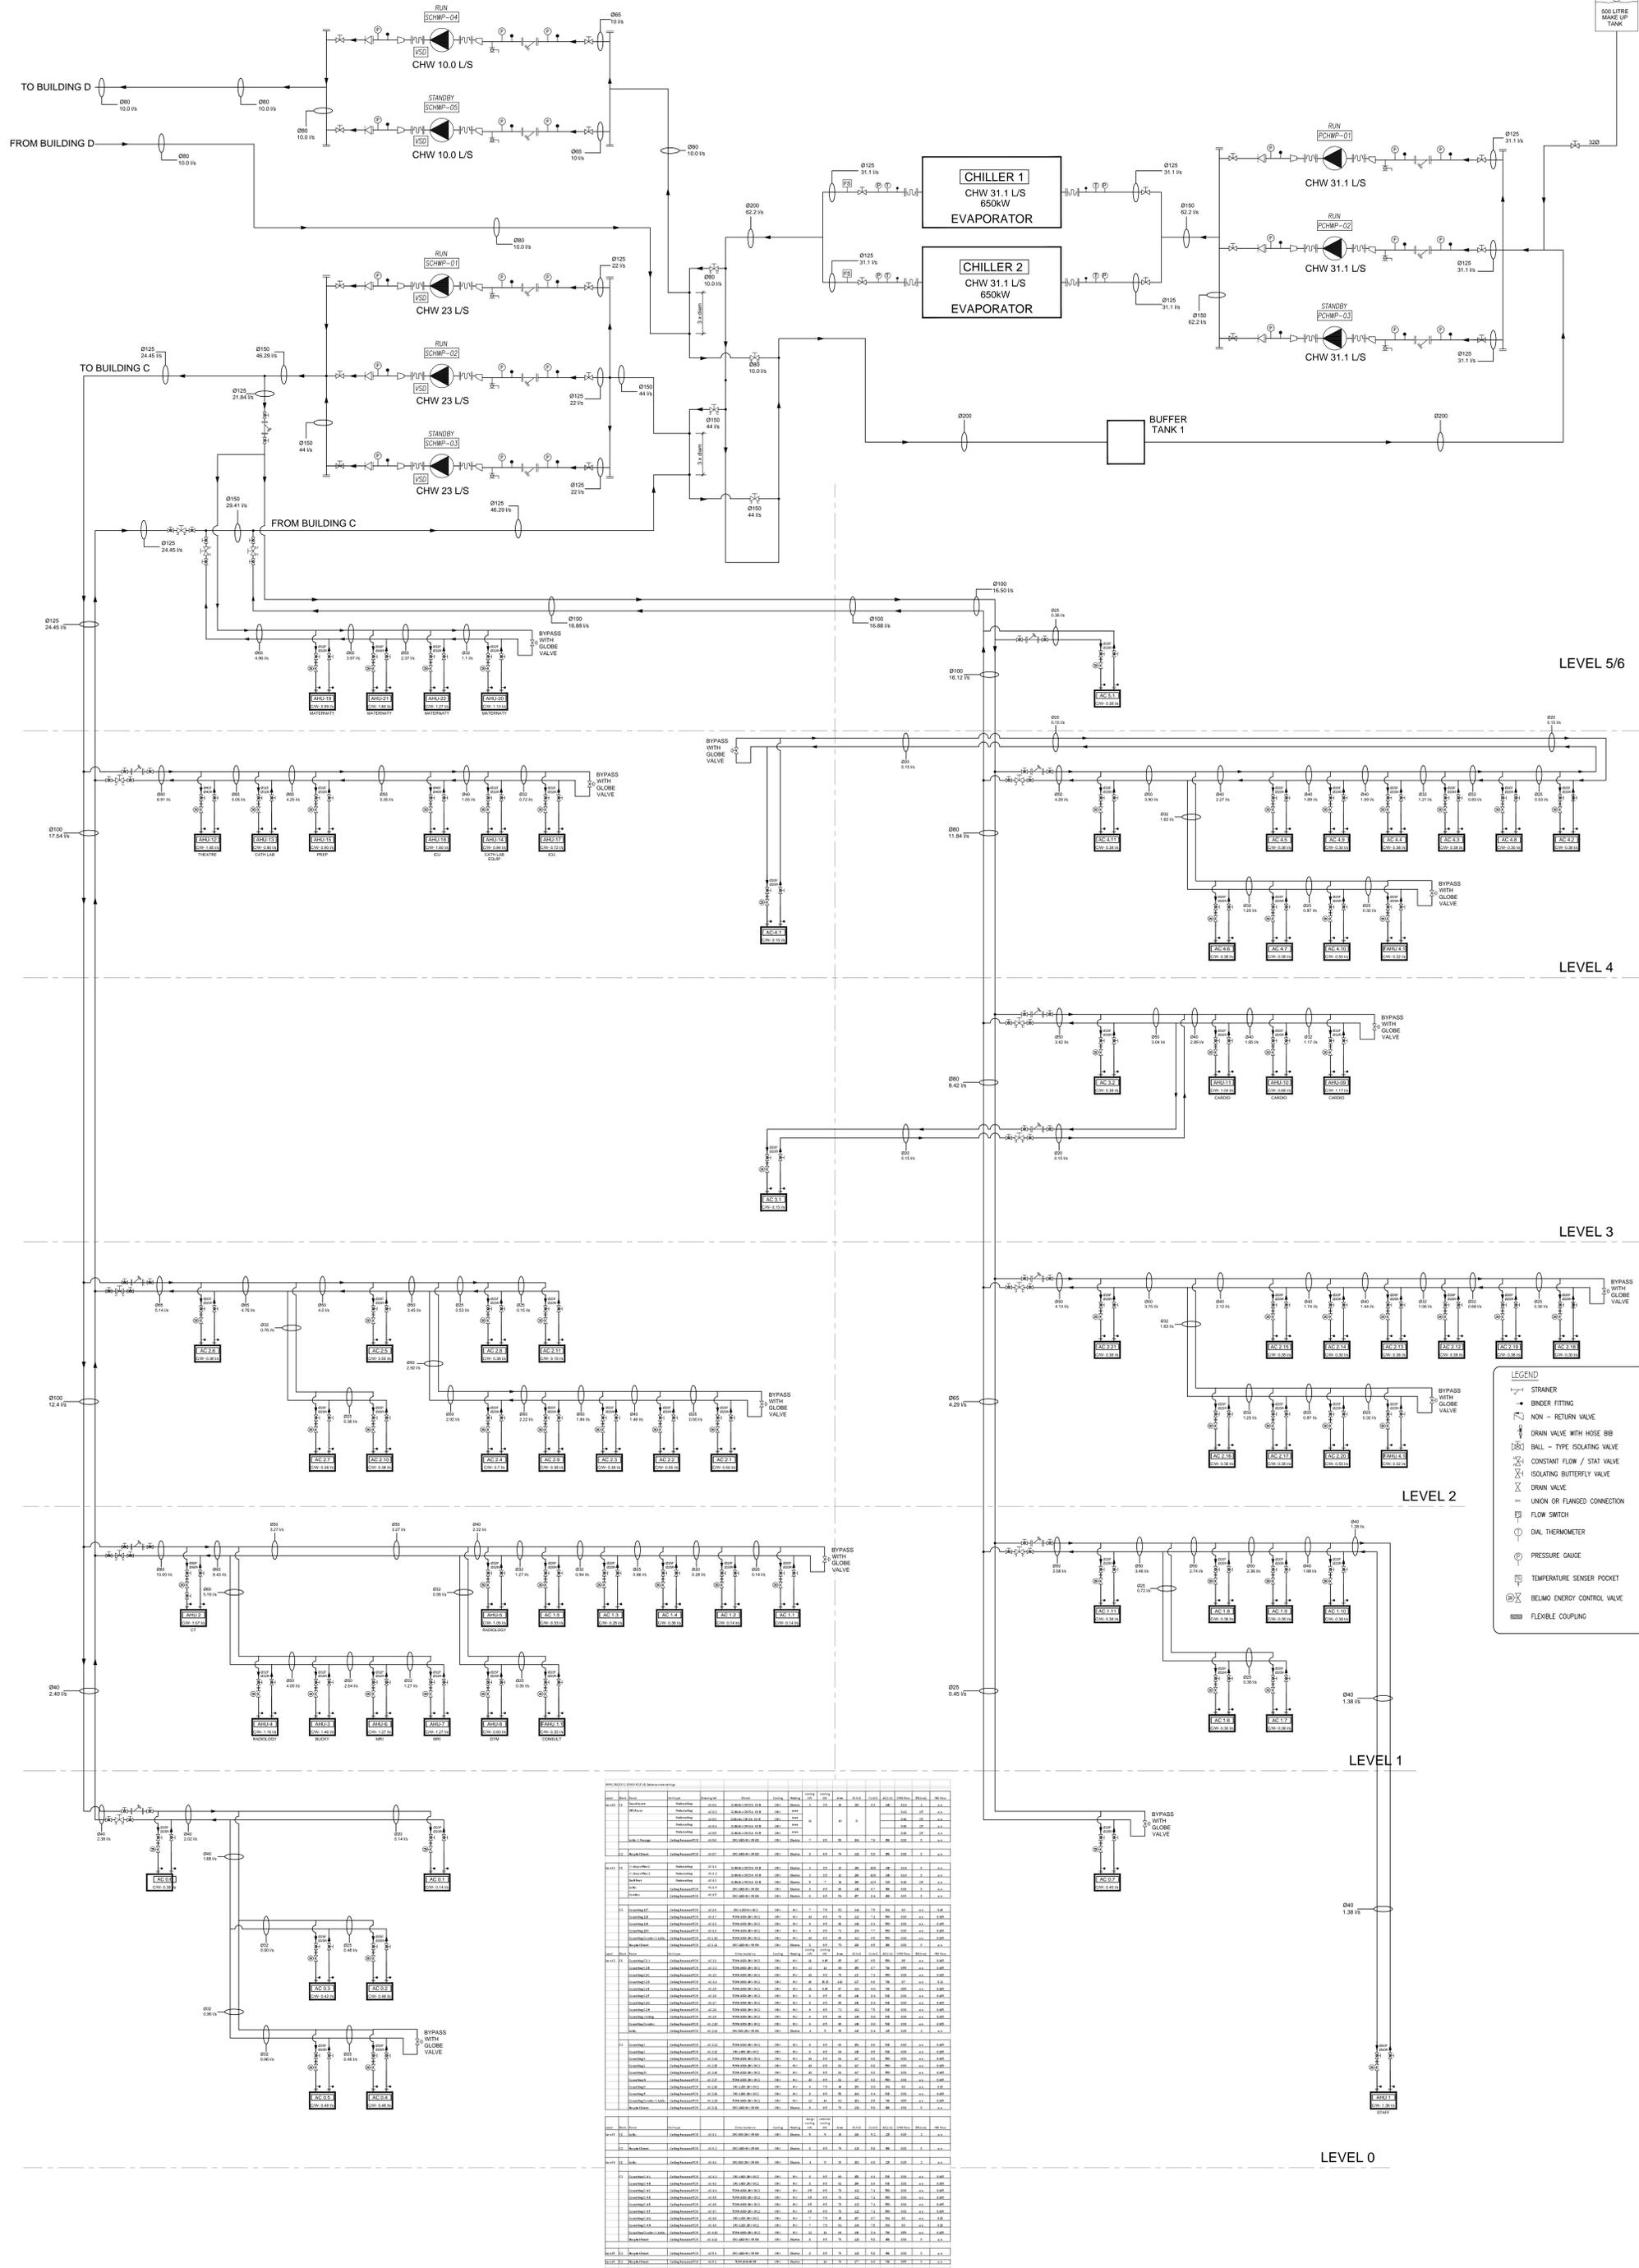

Room No.	Room Name	Flow Rate (L/S)	Pressure (kPa)	Temperature (°C)	Notes
0100	TO BUILDING D	10.0	10.0	10.0	
0100	FROM BUILDING D	10.0	10.0	10.0	
0125	TO BUILDING C	24.45	24.45	24.45	
0125	FROM BUILDING C	24.45	24.45	24.45	
0100	TO LEVEL 5/6	16.50	16.50	16.50	
0100	TO LEVEL 4	11.84	11.84	11.84	
0100	TO LEVEL 3	8.42	8.42	8.42	
0100	TO LEVEL 2	4.29	4.29	4.29	
0100	TO LEVEL 1	0.45	0.45	0.45	
0100	TO LEVEL 0	1.38	1.38	1.38	

BLOCK C1

BLOCK C2